


Library Reference 4.3.6

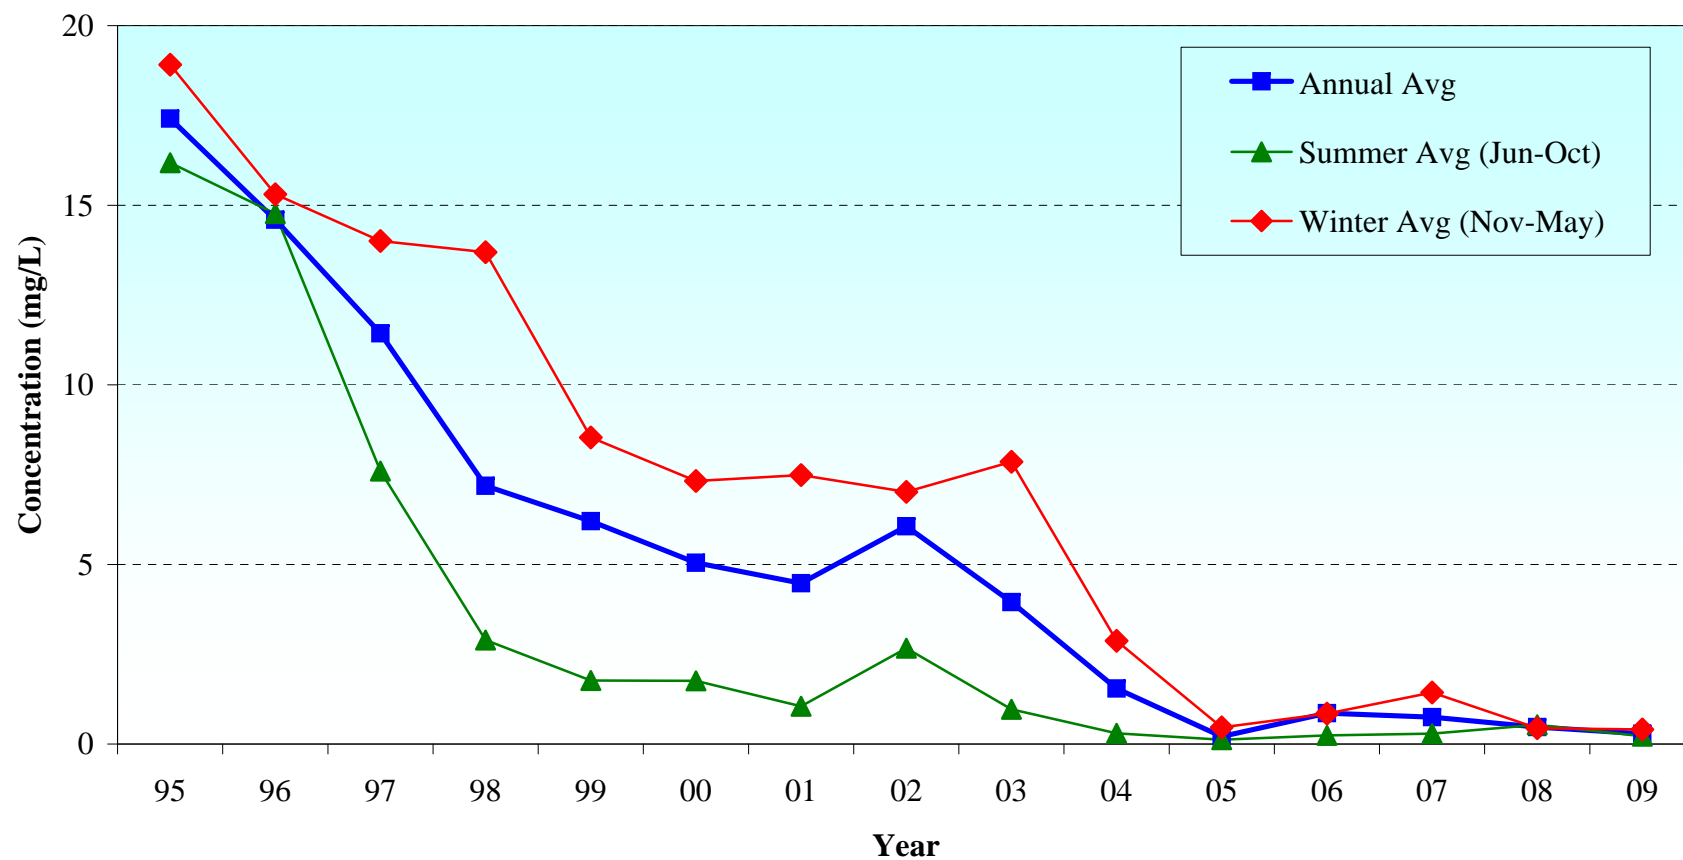

Seasonal average ammonia-N concentration in Metro Outfall 001 effluent over time. The BAF treatment system went on-line in January 2004.