


Library Reference 7.11

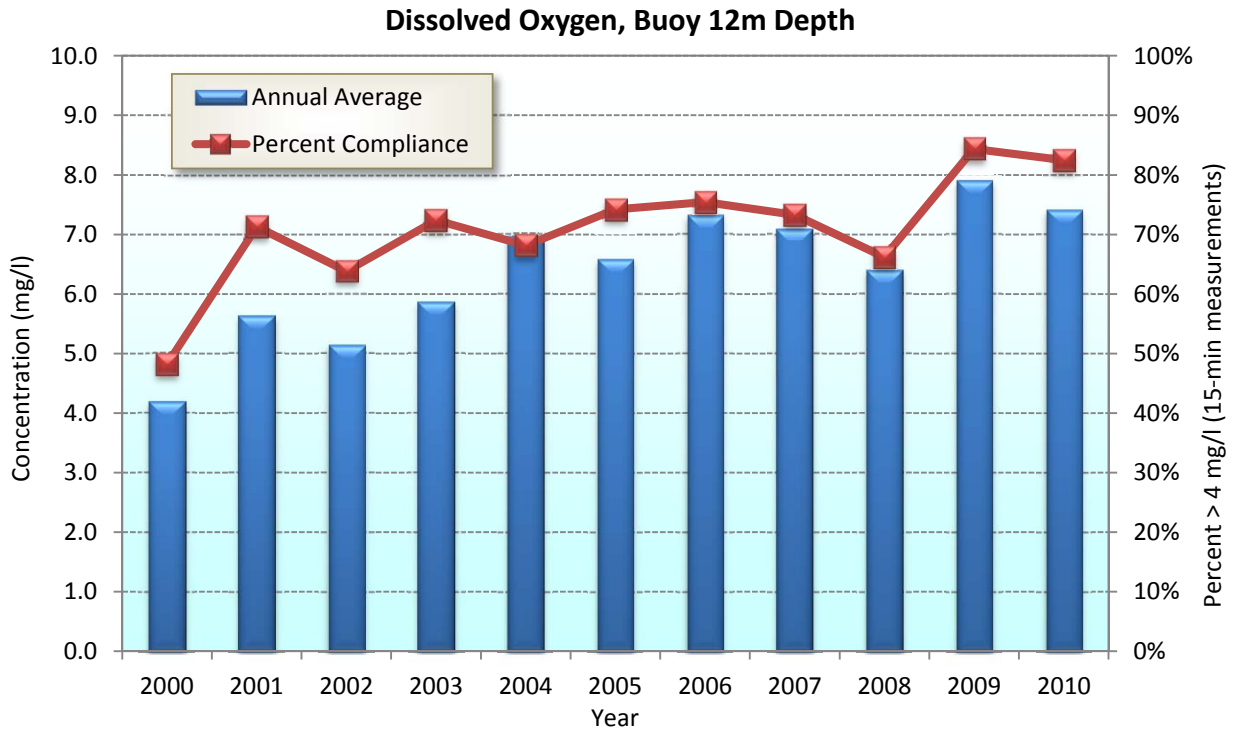

Annual average dissolved oxygen concentrations based on 15-minute data collected from Onondaga Lake in-situ buoy at South Deep, depth 12m. Percent compliance represents percent of 15-min values that were greater than 4 mg/l (Ambient water quality standard for instantaneous measurements of DO in Class B and C waters).